



2007 CA ACCESSIBILITY
REQUIREMENTS

General- If fixed or built-in seating, tables or counters (including, but not limited to, study carrels and student laboratory stations), are provided in public, common use, or general employee areas, at least five percent (5%), but not less than one, must be accessible as detailed below. 1122B.1 4.1.3(18)

Height of tables or counters is between 28" - 34" from the floor or ground.
1122B.4 4.32.4 Fig. 105

NOTE: Where a single counter contains more than one transaction station, such as (but not limited to) a bank counter with multiple teller windows or a retail sales counter with multiple cash register stations, at least 5 percent (5%), but never less than one, of each type of station shall be located at a section of counter that is at least 36 inches long and no more than 28" - 34" high. 1122B.4 Fig. 106-B

Fixed tables or counters

Minimum 30" x 48" clear floor space is provided. 1122B.3 4.32.2
Figs. 105, 106-A

One full unobstructed side of the clear floor space adjoins or overlaps an accessible route or another wheelchair clear floor space. 1122B.3 4.32.2

Knee clearance at tables, counters and work surfaces is at least 27" high, 30" wide and 19" deep. 1122B.3 4.32.3 Figs. 105, 106-A

EXCEPTION: Knee clearance is not required at checkout counters or service counters. 1122B.3

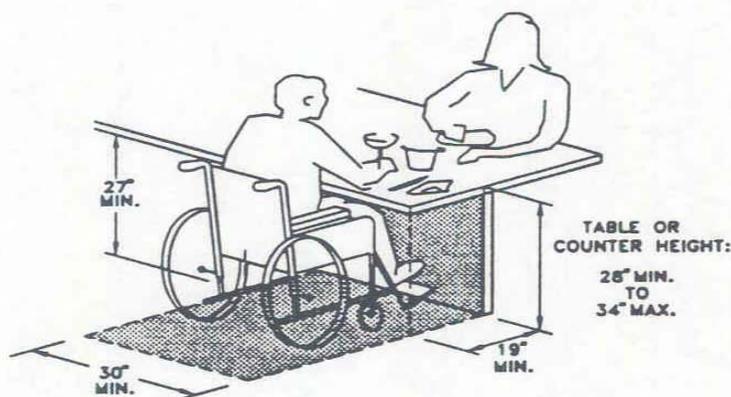


FIGURE 11A-11 & 11B-5C
REQUIRED KNEE CLEARANCES