




# Community Development Permit Center FURNACE IN CLOSET (M3)

ONE TWIN PINES LANE,  
SUITE 110  
BELMONT, CA 94002  
(650) 595-7422  
www.belmont.gov

LAST REVISED:  
2022 CA MECHANICAL CODE  
904.1 & 904.2

BUILDING OFFICIAL:  
DINO FRANCESCONI

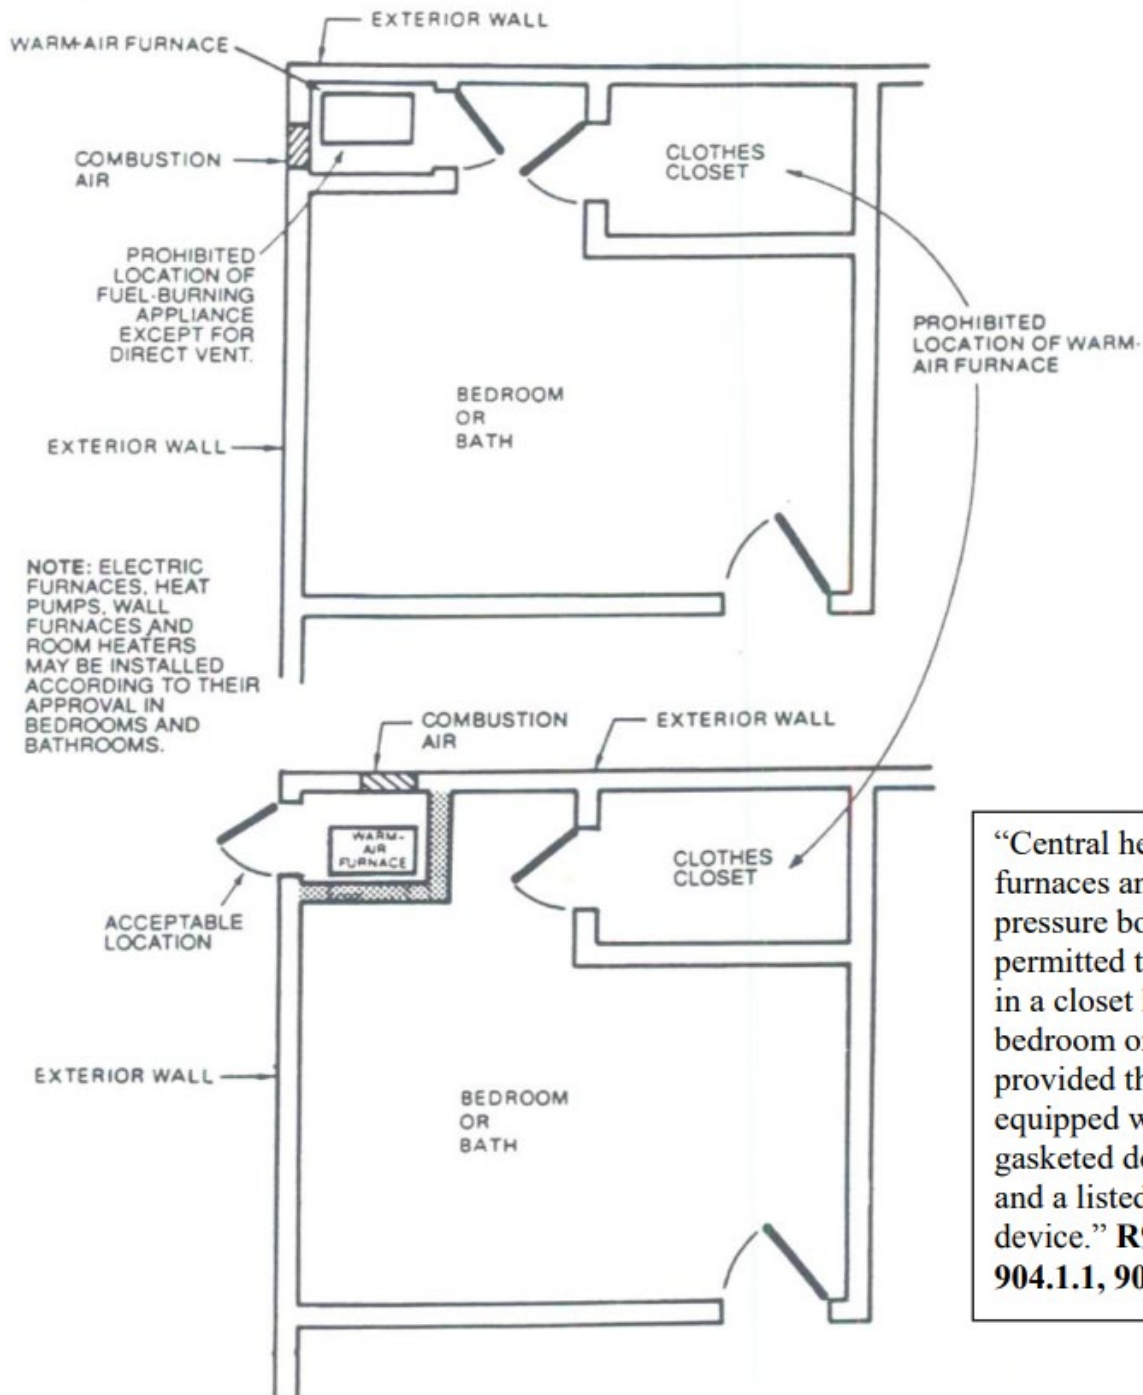

“Central heating furnaces and low-pressure boilers shall be permitted to be installed in a closet located in the bedroom or bathroom, provided the closet is equipped with a listed, gasketed door assembly, and a listed self-closing device.” **R904.1, 904.1.1, 904.1.2**