



ONE TWIN PINES LANE,
 SUITE 110
 BELMONT, CA 94002
 (650) 595-7422
 www.belmont.gov

Community Development Permit Center GAS VENT TERMINATION (M12)

LAST REVISED:
2022 CA MECHANICAL CODE
802.5.4 & 802.6

BUILDING OFFICIAL:
DINO FRANCESCONI

FIG. 57

B Vent Termination

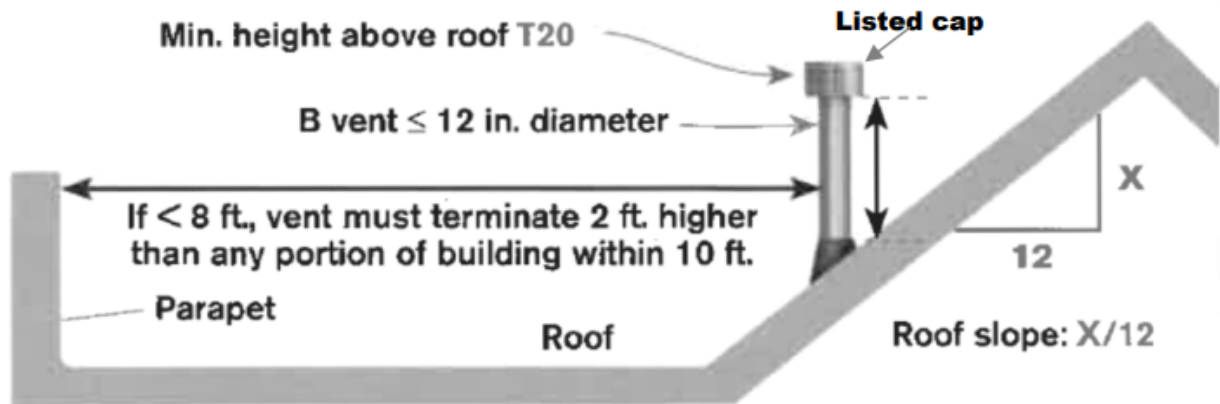


TABLE 20		B VENT TERMINATION (F57) [F2427.6.3] {T802.6.2}	
Roof Slope	Min. Height (ft.)	Roof Slope	Min. Height (ft.)
Flat to 6/12	1	> 11/12 to 12/12	4
> 6/12 to 7/12	1¼	> 12/12 to 14/12	5
> 7/12 to 8/12	1½	> 14/12 to 16/12	6
> 8/12 to 9/12	2	> 16/12 to 18/12	7
> 9/12 to 10/12	2½	> 18/12 to 20/12	7½
> 10/12 to 11/12	3¼	> 20/12 to 21/12	8

802.6.2 Termination Requirements. A gas vent shall terminate in accordance with one of the following:

- (1) Gas vents that are 12 inches (305 mm) or less in size and located not less than 8 feet (2438 mm) from a vertical wall or similar obstruction shall terminate above the roof in accordance with Figure 57 and Table 802.6.2. Gas vents that are over 12 inches (305 mm) in size or are located less than 8 feet (2438 mm) from a vertical wall or similar obstruction, shall terminate not less than 2 feet (610 mm) above a portion of a building within 10 feet (3048 mm) horizontally.